


TYPICALLY CLASS III BACKFILL. USE CLASS II BACKFILL WHERE UNSUITABLE TRENCH MATERIAL IS ENCOUNTERED OR AS DIRECTED BY THE ENGINEER.

PIPE ZONE CLASS II BACKFILL 6" LIFTS

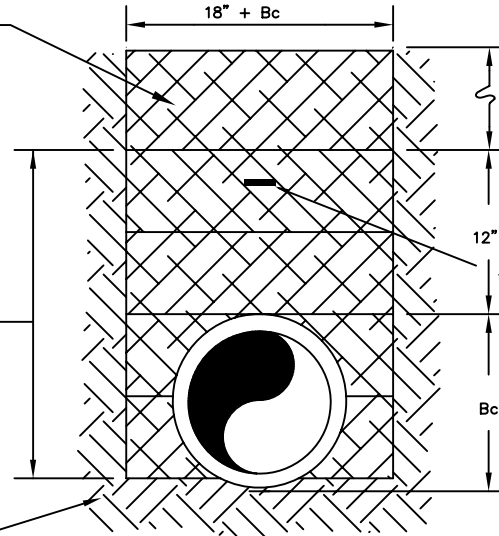


DEPTH VARIES

MAGNETICALLY DETECTABLE TAPE  
18" - 24" BELOW GRADE  
USE FOR ALL TYPES OF PIPE

UNDISTURBED SOIL

NOTE: REFER TO HIGHWAY DEPARTMENT, CITY, OR COUNTY PERMITS FOR ADDITIONAL REQUIREMENTS.

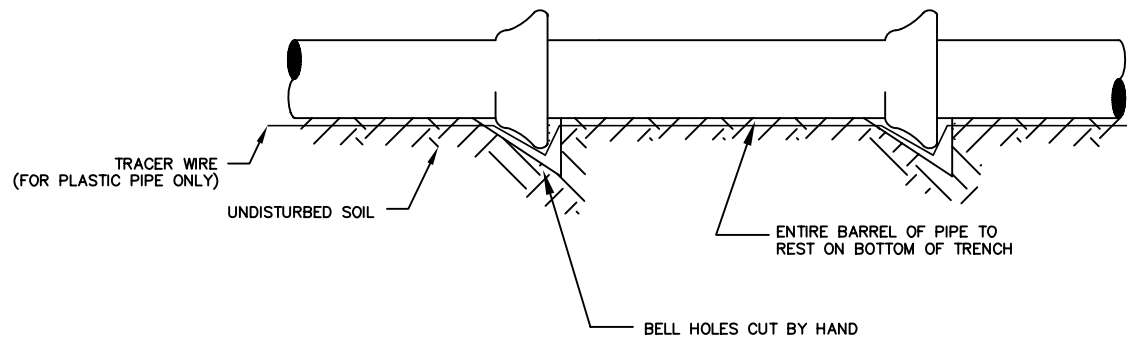

### WATER MAIN BEDDING

CHARLESTON WATER SYSTEM

WATER MAIN BEDDING

APPROVED BY:

CWS

DATE:

MAR 2000

DRAWING NO.

1

SCALE:

NTS

REVISED:

FEB 2010