


- NOTES:
1. MAINS GREATER THAN 8" SHALL USE A FIRE HYDRANT FOR A BLOWOFF.
 2. BLOWOFF MATERIAL SHALL BE 2" FOR A 6" MAIN AND 3" FOR AN 8" MAIN.
 3. NO ACTIVE SERVICES SHALL BE INSTALLED BETWEEN THE VALVE AND THE BLOWOFF.

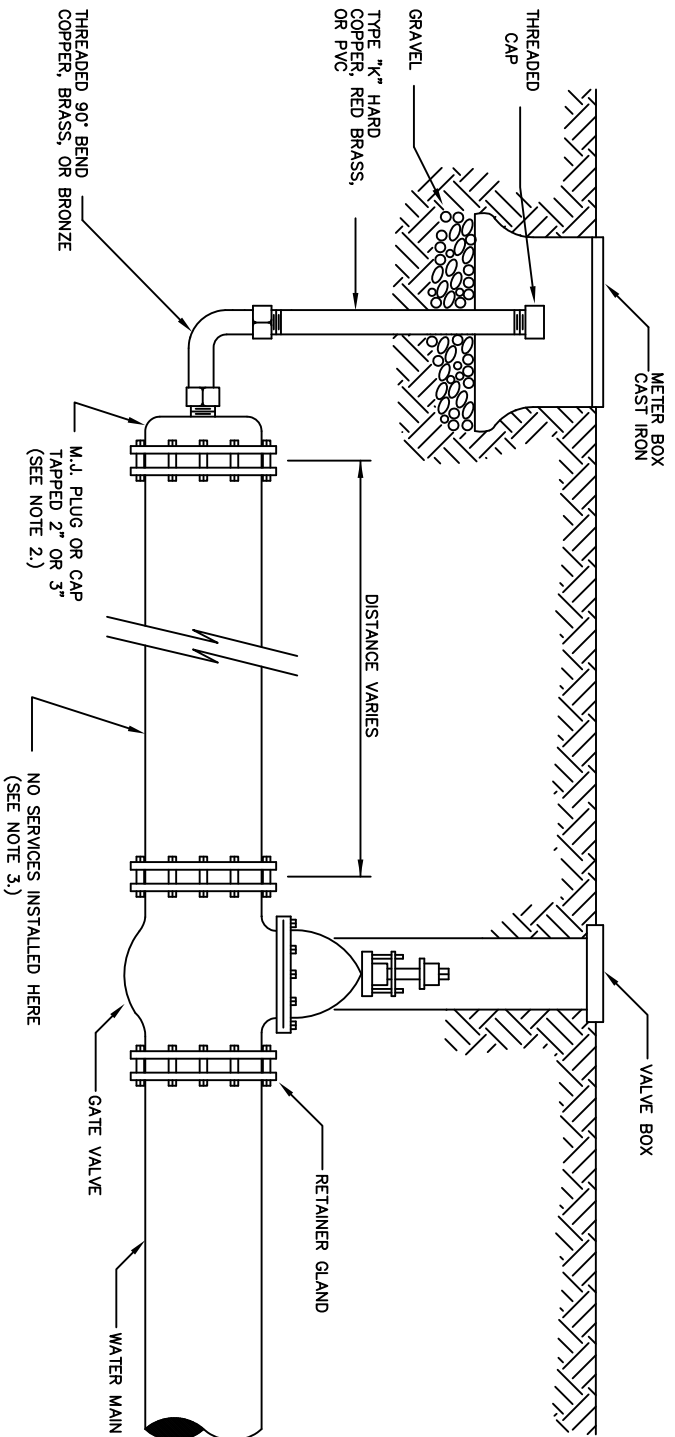

TEMPORARY BLOWOFF
FOR 6" AND 8" MAINS
(FOR MAINS TO BE EXTENDED LATER)

CHARLESTON WATER SYSTEM

TEMPORARY BLOWOFF
FOR 6" AND 8" MAINS

APPROVED BY:

CWS

DATE:

MAY 2002

DRAWING NO.

SCALE:

NTS

REVISED:

FEB 2010

15