


- NOTES:**
1. Contractor will provide all material and install services under CWS supervision.
 2. All taps will be made in accordance with CWS Minimum Standards and AWWA guidelines for tapping through polyethylene encasement.
 3. All meter boxes shall be installed perpendicularly to the property line, as shown herein.

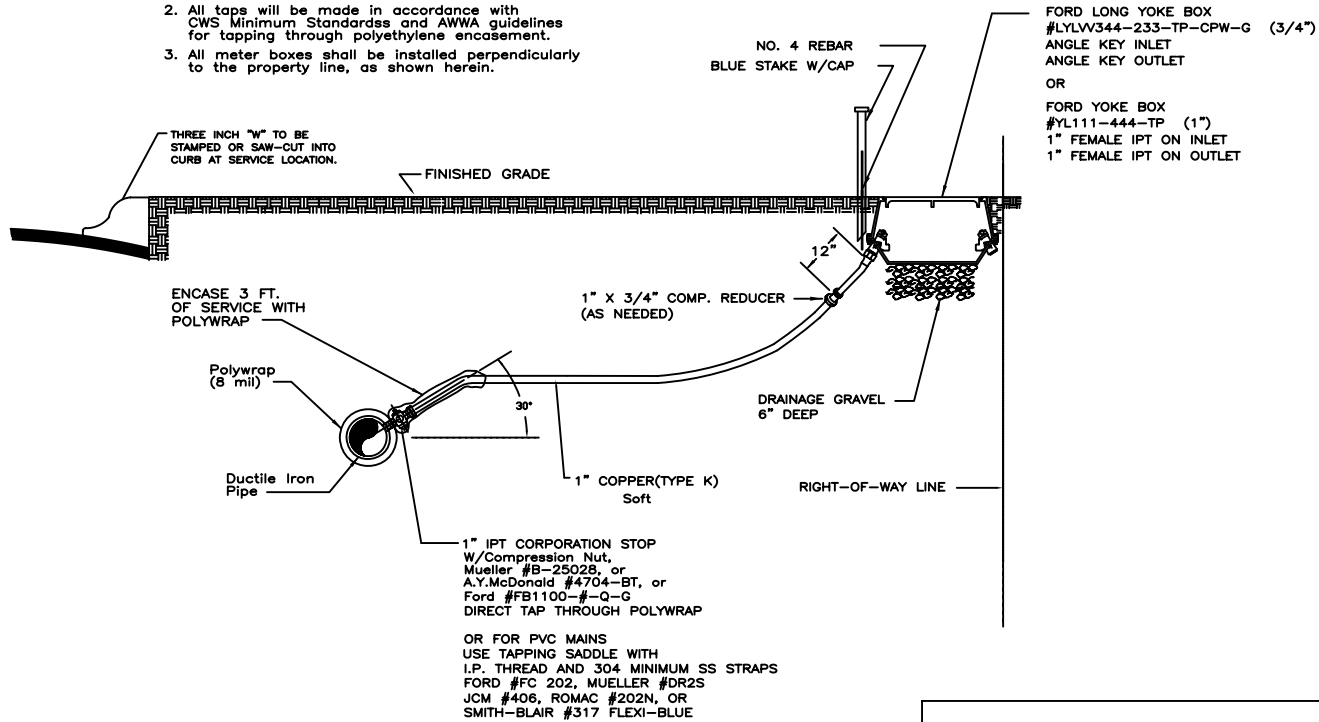

3/4" - 1" SINGLE WATER SERVICE
NEAR SIDE

CHARLESTON WATER SYSTEM

3/4" - 1" SINGLE WATER SERVICE
NEAR SIDE

APPROVED BY: CWS	DATE: MAR 2003	DRAWING NO. 19
SCALE: NTS	REVISED: FEB 2010	